



TYPICAL SECTION

EXPANSION JOINT MATERIAL TO BE 1/2" BITUMINUS PRODUCT.

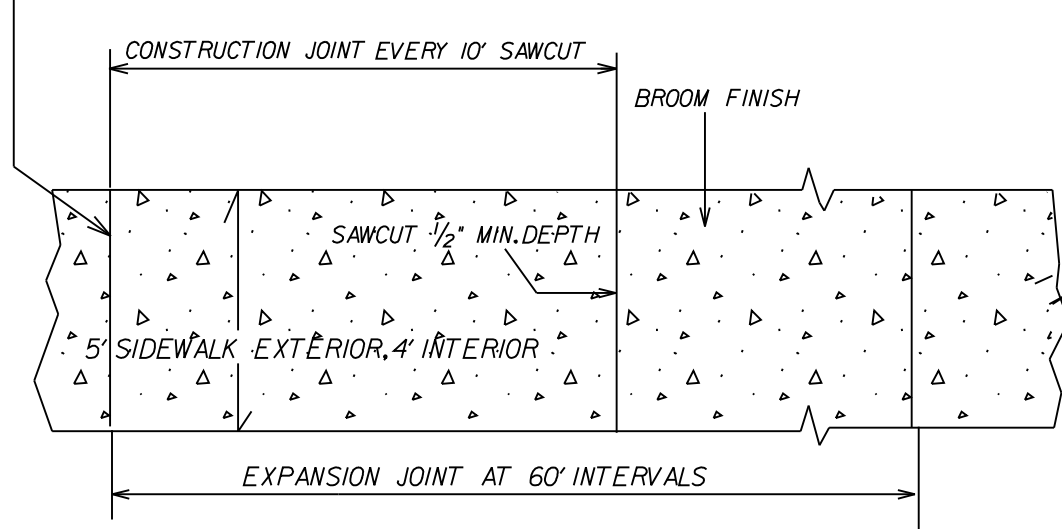

PLAN VIEW

SIDEWALK RAMP DETAIL

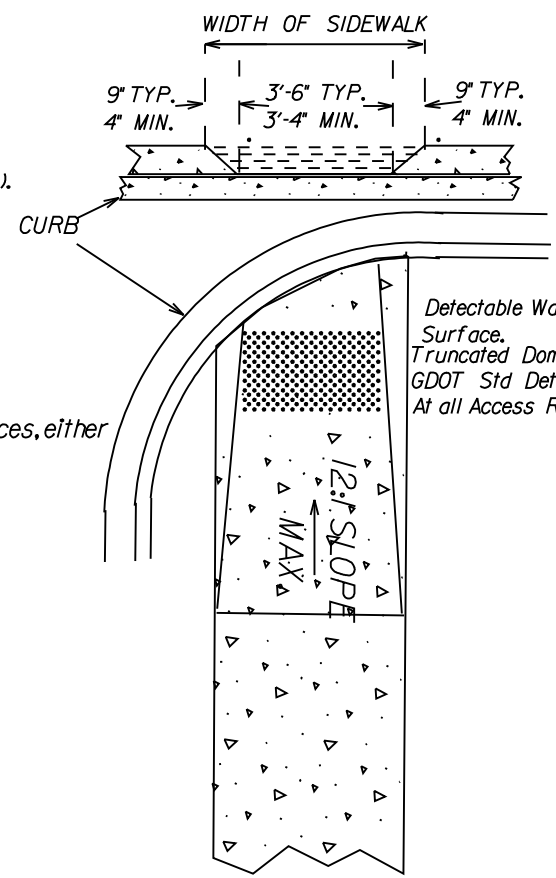


NOTE: ACCESS RAMPS ARE TO BE PLACED AT ALL DRIVES, INTERSECTIONS AND AT ALL CURB ENCROACHMENTS. SEE GEORGIA DOT STANDARD A3 (FKA STANDARD 903W).

WHERE UTILITY STRUCTURES CONFLICT, WHERE SIDEWALK GEOMETRY VARIES AT SKEWED INTERSECTIONS OR IN OTHER SPECIAL CASES, THE SIDEWALK/RAMP MAY BE MODIFIED BY THE DESIGNER, PROVIDED THE WIDTH REMAINS CONSTANT AND NO PART OF THE RAMP IS STEEPER THAN 12:1.

1/2" EXPANSION MATERIAL SHALL BE PLACED WHERE SIDEWALK TIES INTO A STRUCTURE OR TERMINATES AT CURB, RAMPS OR DRIVEWAYS OR AT 60' MIN.

* Detectable Warning surface shall color contrast visually with adjoining surfaces, either light-on-dark or dark-on-light.

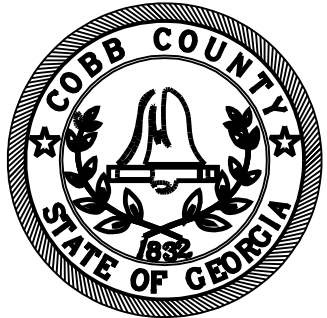

SIDEWALKS
DETAIL 113