DETAIL 02713-11
COBB COUNTY WATER SYSTEM
DEAD-END FIRE HYDRANT INSTALLATION

JANUARY 23,2002

AGENCY DIRECTOR

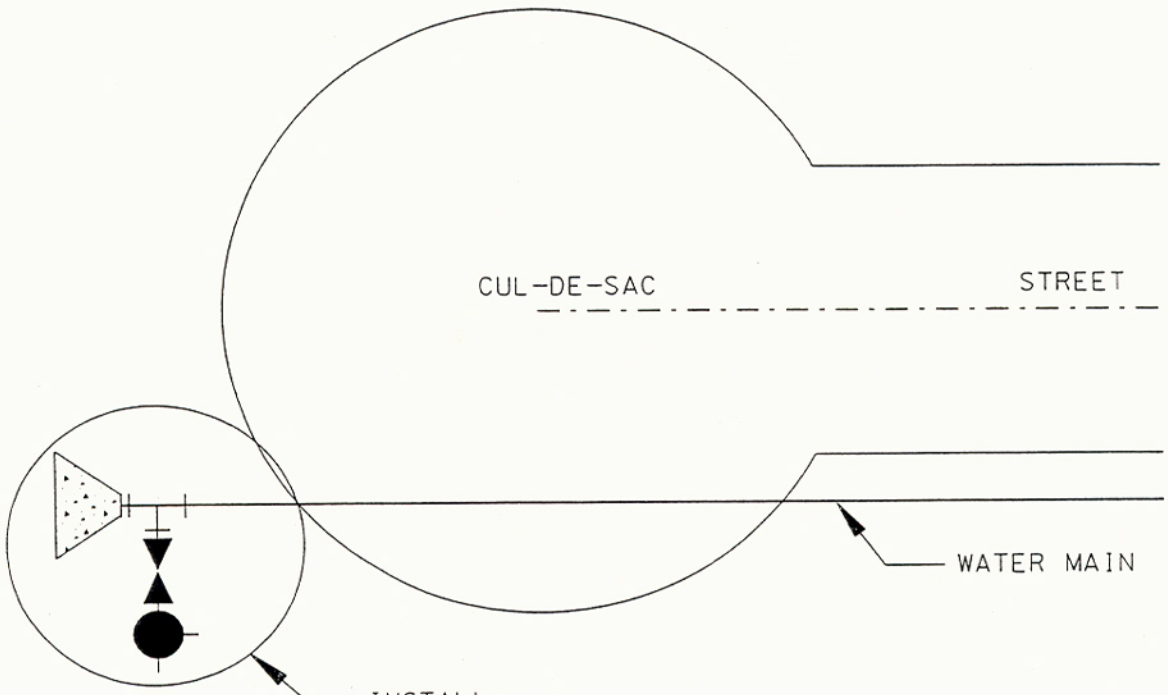

INSTALL:
1 - 6" GATE VALVE
1 - 6"X6" M.J.F.H. TEE
1 - 6" PLUG
1 - 6"x36" ANCHOR COUPLING
1 - FIRE HYDRANT
1 - THRUST BLOCK (SEE DETAIL 02713-12 TEE/PLUG FOR CORRECT DIMENSIONS)