DETAIL 03410-3
COBB COUNTY WATER SYSTEM
SHALLOW MANHOLE (< 4′ - 6″ DEPTH)
(SECTION VIEW)

MAY 1, 2001

AGENCY DIRECTOR

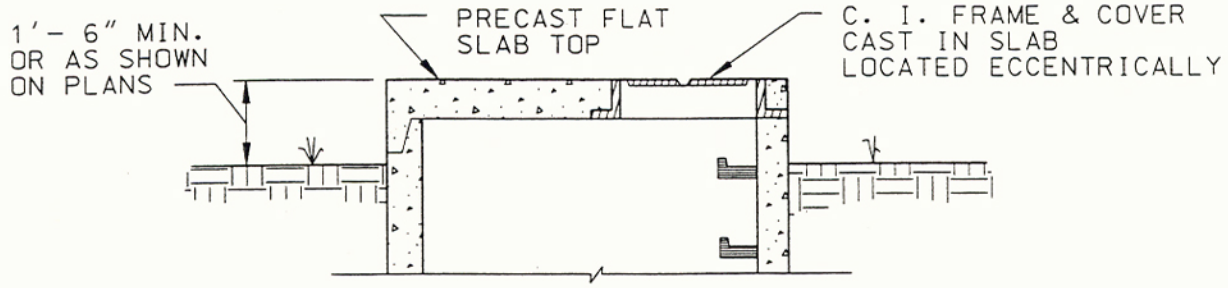

PARTIAL SECTION

(Typical For Projecting Top)

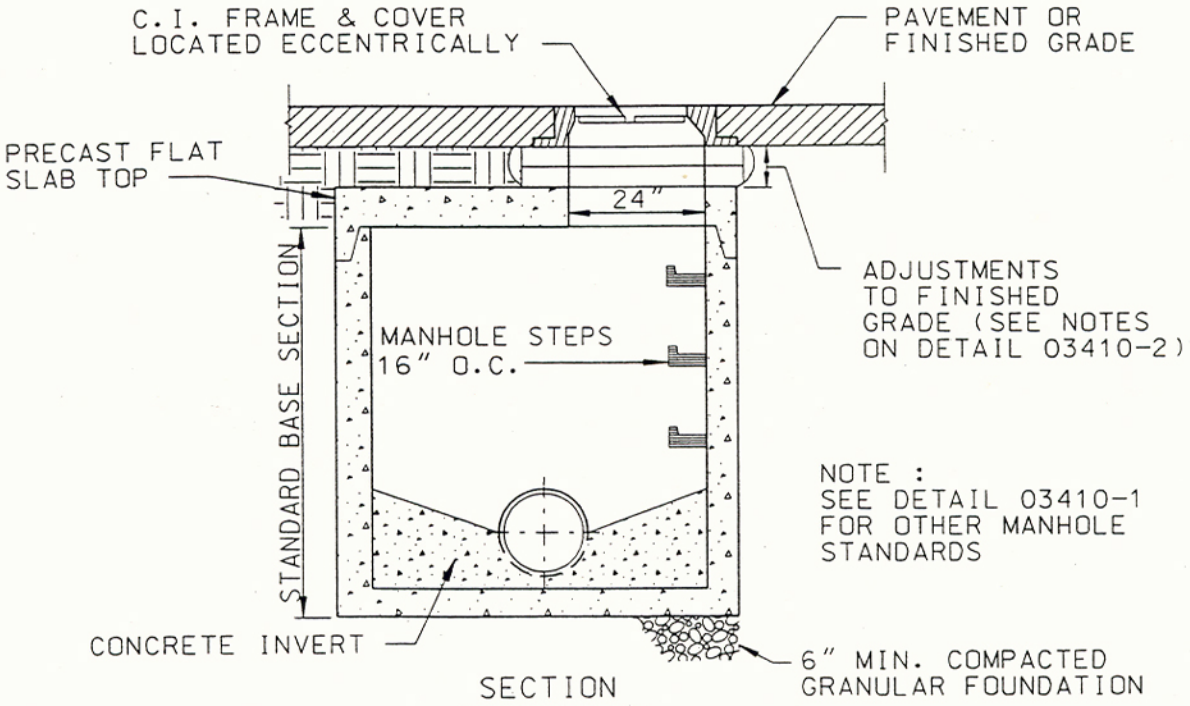

SECTION

(Typical for Flush Top)